June 12, 2000

Larimer County Building Dept.
Requirements for a

TYPICAL LOAFING SHED

LARIMER COUNTY
COMMITTED TO EXCELLENCE

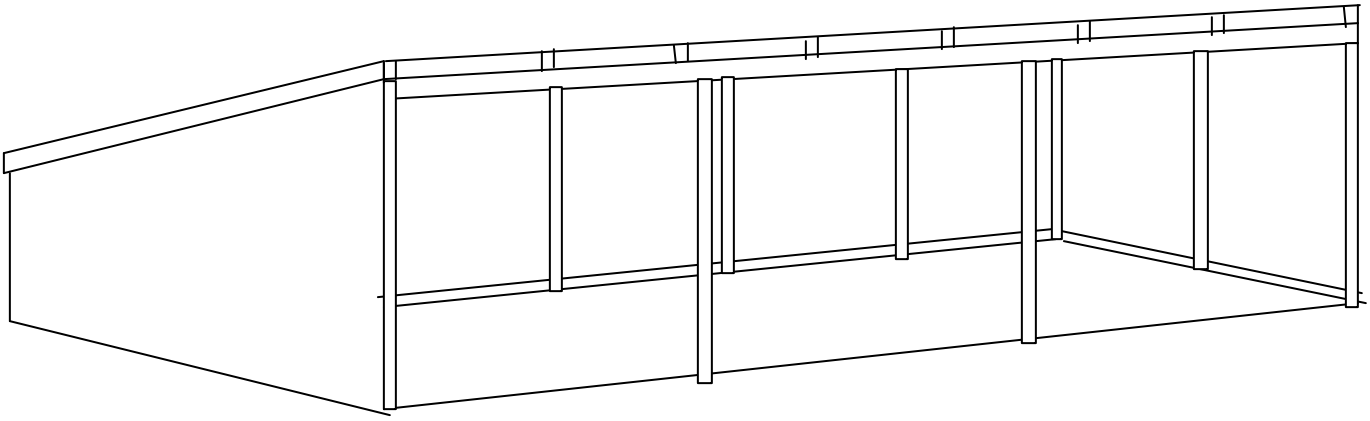

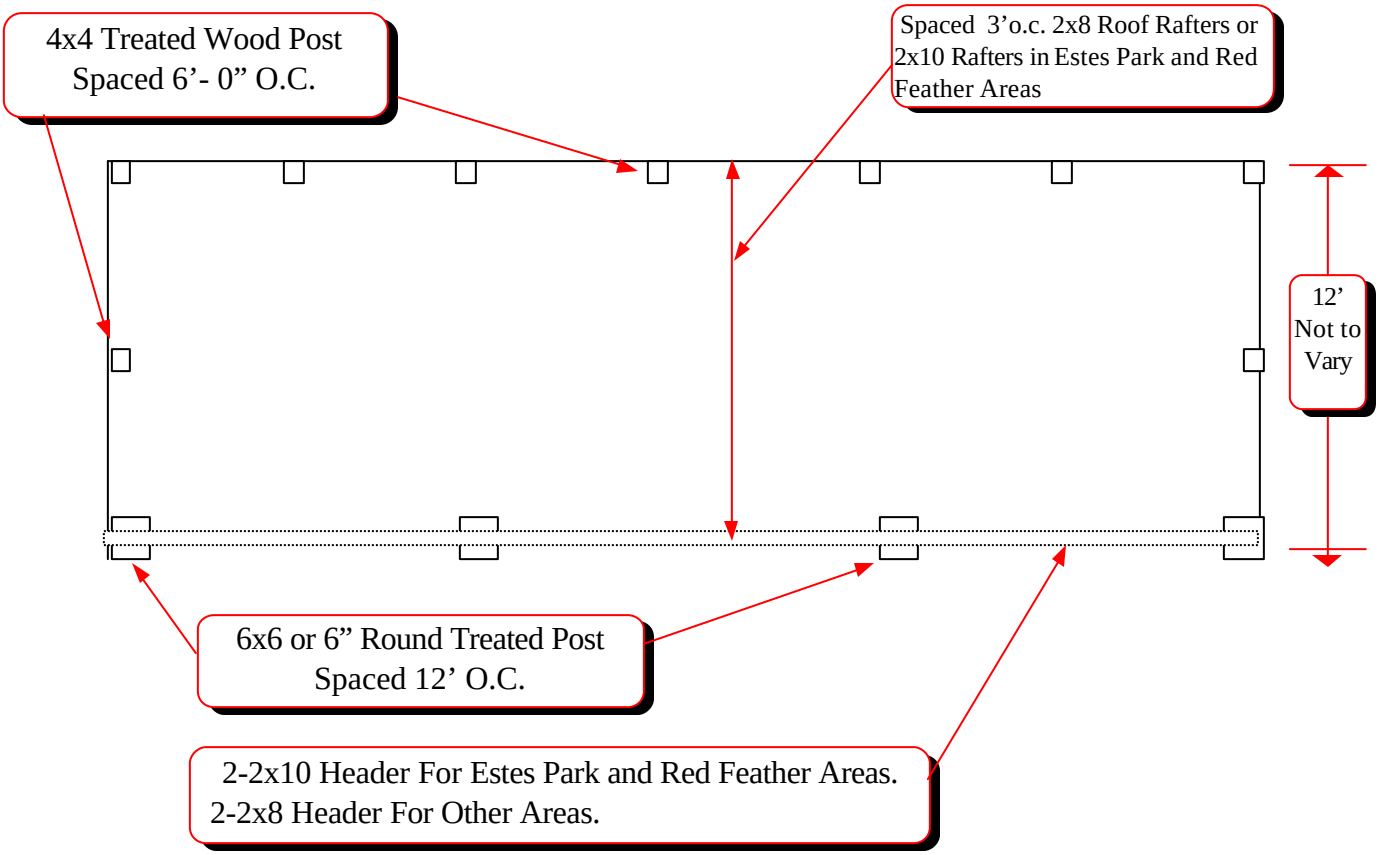

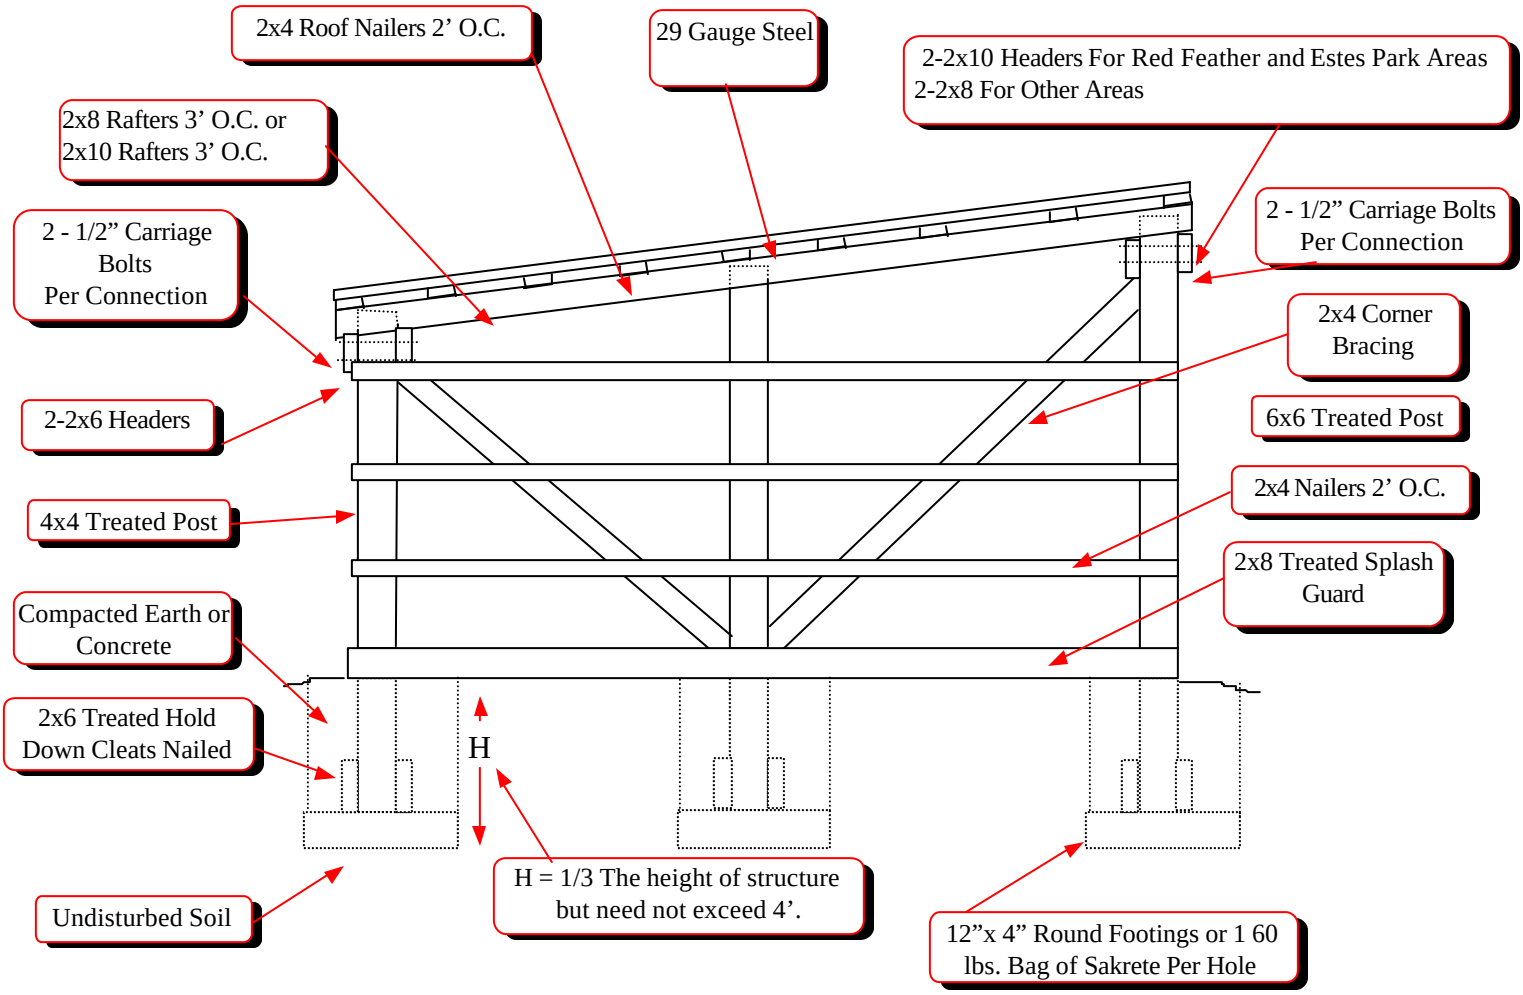
2x4 Roof Nailers 2' O.C.
29 Gauge Steel
2-2x10 Headers For Red Feather and Estes Park Areas
2-2x8 For Other Areas
2x8 Rafters 3' O.C. or
2x10 Rafters 3' O.C.
2 - 1/2" Carriage Bolts
Per Connection
2 - 1/2" Carriage Bolts
Per Connection
2x4 Corner Bracing
2-2x6 Headers
6x6 Treated Post
2x4 Nailers 2' O.C.
4x4 Treated Post
2x8 Treated Splash Guard
Compacted Earth or Concrete
2x6 Treated Hold Down Cleats Nailed
H
H = 1/3 The height of structure but need not exceed 4'.
Undisturbed Soil
12"x 4" Round Footings or 1 60 lbs. Bag of Sakrete Per Hole

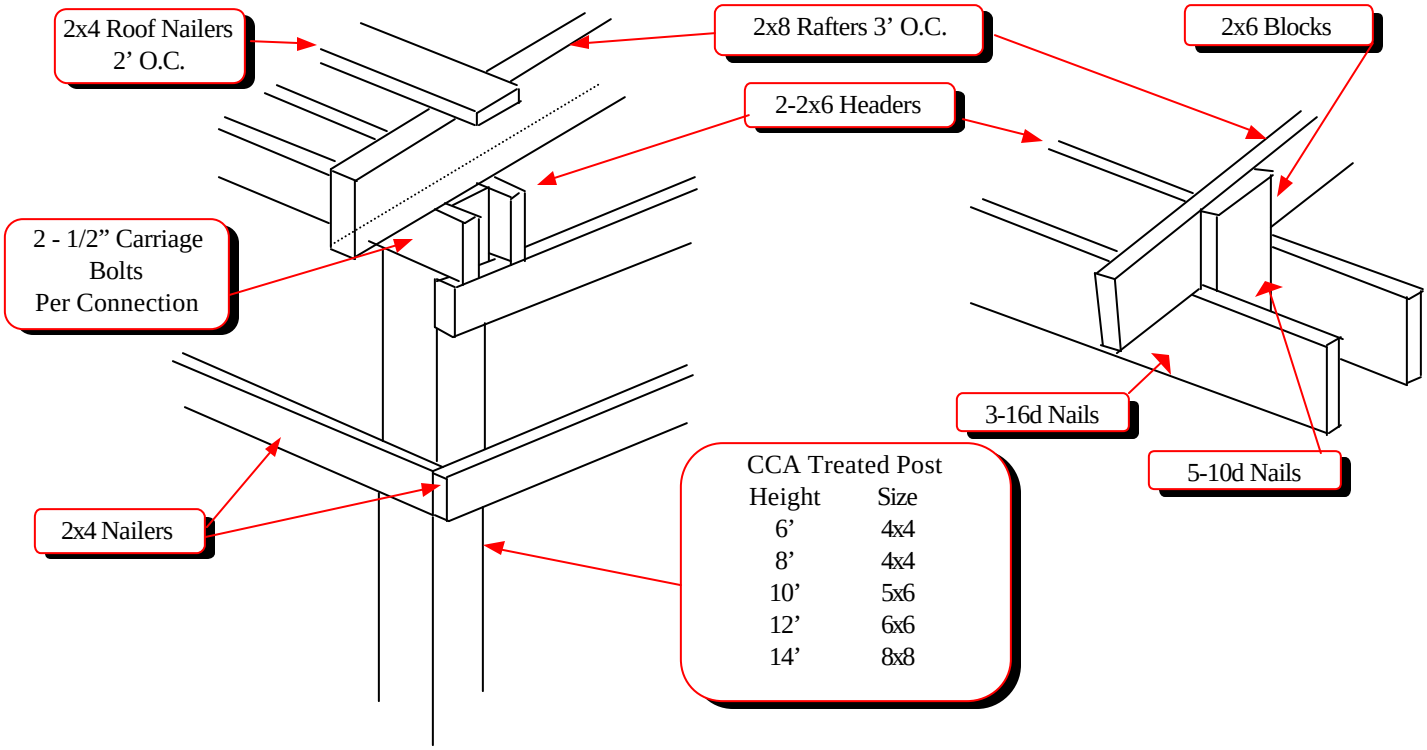
2x4 Roof Nailers
2' O.C.
2x8 Rafters 3' O.C.
2x6 Blocks
2-2x6 Headers
2 - 1/2" Carriage Bolts
Per Connection
3-16d Nails
5-10d Nails
2x4 Nailers
CCA Treated Post
Height Size
6' 4x4
8' 4x4
10' 5x6
12' 6x6
14' 8x8